

ACCESSORY KIT INSTALLATION MANUAL

MICROCHANNEL COIL, PUSH MOUNT STRAP FIELD KIT S1-32516159000

FOR USE WITH MODELS: TCGD & GCGD

GENERAL INFORMATION

Head of cable tie presses against the side of the top to act as a separator between the screw and coil.

IMPORTANT - Failure to use cable ties could result in coil damage.

INSTALLATION

1. Remove all screws securing top assembly to coil guard and control box cover.
2. Lift and rotate top assembly approximately 1/8 turn to rest on top of coil.
3. Insert cable tie into coil immediately next to the coil guard coined rod so that cable tie head is in straight portion of coil. Refer to Figures 1 & 4.
4. Wrap tie around top of coil and secure into head keeping correct orientation of cable tie head. Refer to Figure 2.
5. Trim excess tie as necessary. Refer to Figure 3.
6. Repeat steps for all 4 locations around coil. Refer to Figure 4.
7. Reorient top on unit starting with coil guard opposite control box and secure with screws.

NOTE: Units with microchannel tube damage must be leak tested and unit not used if leak is detected or damage to tube is severe.

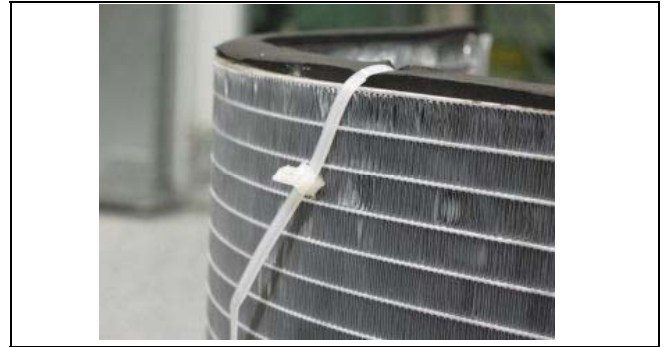


FIGURE 2



FIGURE 3



FIGURE 1

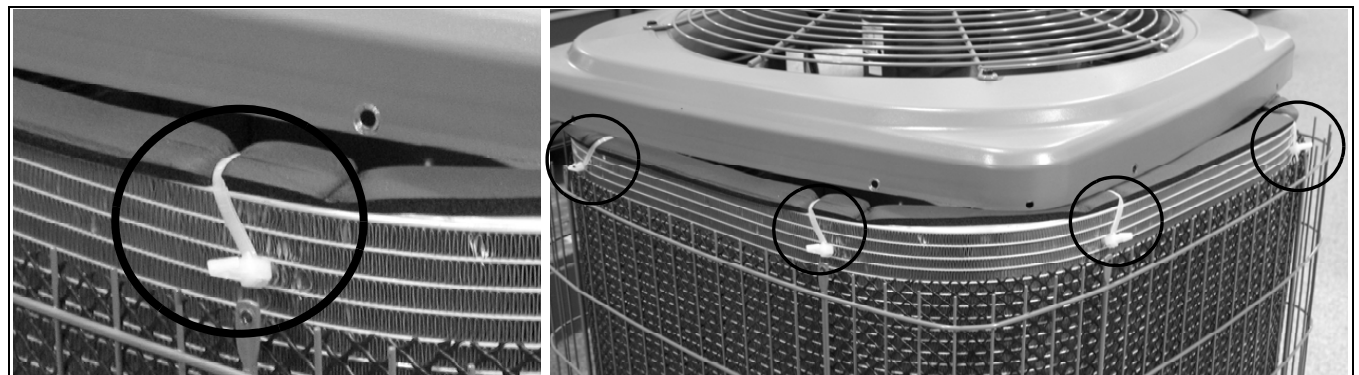


FIGURE 4

Subject to change without notice. Printed in U.S.A.
Copyright © by York International Corp. 2007. All rights reserved.

035-21370-001-A-0707
Supersedes: Nothing