


JOB NAME \_\_\_\_\_ LOCATION \_\_\_\_\_  
 PURCHASER \_\_\_\_\_ ORDER NO. \_\_\_\_\_  
 ENGINEER \_\_\_\_\_  
 SUBMITTED TO \_\_\_\_\_ FOR: Reference Approval Construction  
 SUBMITTED BY \_\_\_\_\_ DATE \_\_\_\_\_

UNIT DESIGNATION: Schedule No. \_\_\_\_\_ MODEL NO. \_\_\_\_\_

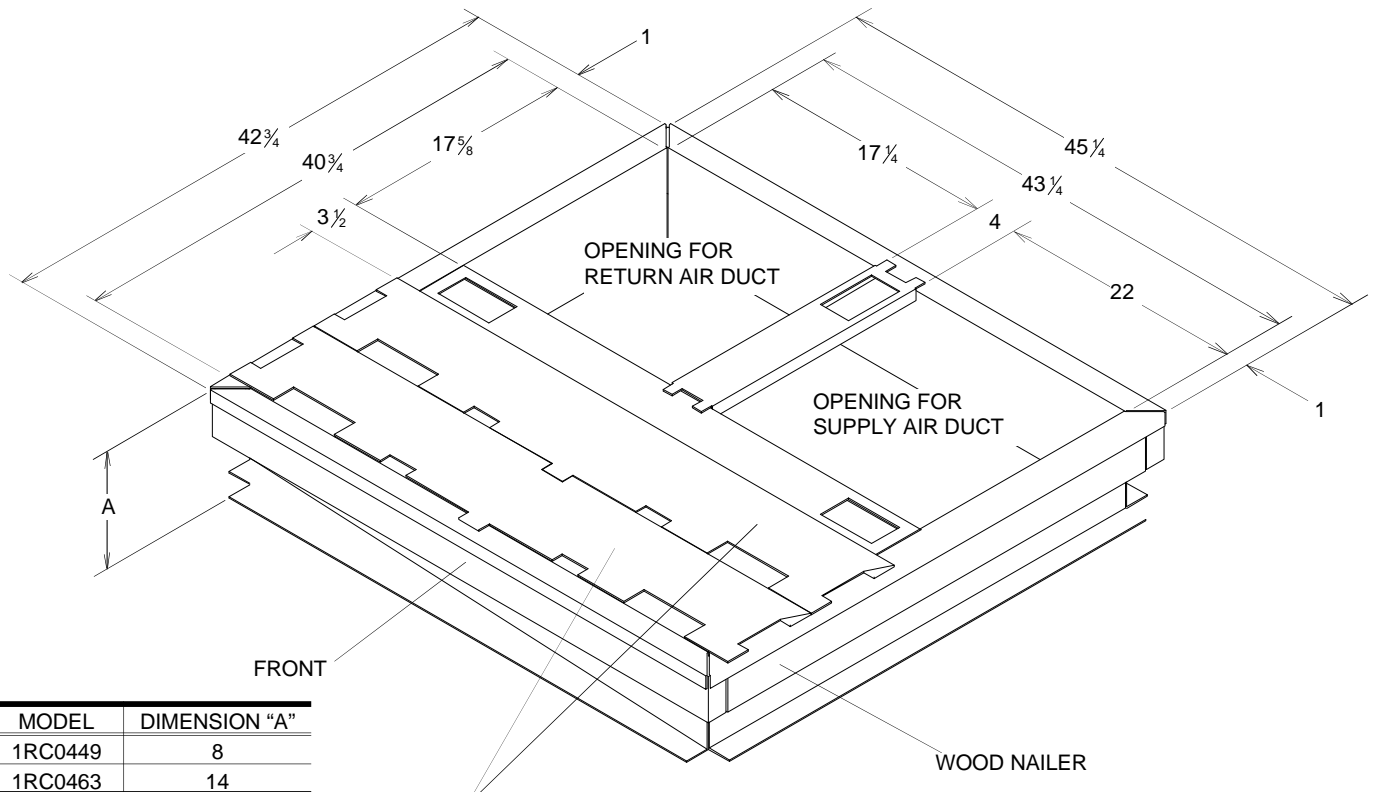

| MODEL   | DIMENSION "A" |
|---------|---------------|
| 1RC0449 | 8             |
| 1RC0463 | 14            |

| RECOMMENDED DUCT SIZE |                   |
|-----------------------|-------------------|
| SUPPLY AIR DUCT       | 17 1/8" x 21 1/2" |
| RETURN AIR DUCT       | 17 1/8" x 16 3/4" |

NOTE:

1. Roof curb is built to NRCA standards.
2. Roof curb is constructed of 18 gauge G90 steel.
3. Unit duct supports are provided.
4. Full perimeter 1 x 4 wood nailer.
5. Curbs are shipped unassembled.
6. Corner hinge pins are used for assembly.

Roof opening; 43 1/8" long x 18 1/8" wide

Subject to change without notice. Printed in the U. S. A.

**ROOF CURB**  
**MODELS: 1RC0449 AND 1RC0463**

FOR THE FOLLOWING UNITS;  
 BUA, BUH, DPB, DPH, DYA, DYH

FORM 530.46-SD10L (197)

Supersedes: 530.46-SD10L (496)

