

INSTALLATION INSTRUCTION

COIL GUARD KITS 1CG0406, 1CG0407, 1CG0408, 1CG0409 1CG0410, 1CG0416, 1CG0417, & 1CG0418

Supersedes: 550.23-N1.3V (398)



550.23-N1.3V (600)

035-14845

FOR 7.5 & 20 TON SPLIT-SYSTEM CONDENSING UNITS AND HEAT PUMPS

INSTALLATION

Insert the coil guard into the corner post and rotate it to ward the coil until it lines up the eyelets on the guard with the holes in the sheet metal of the corner post. Insert and tighten the screws.

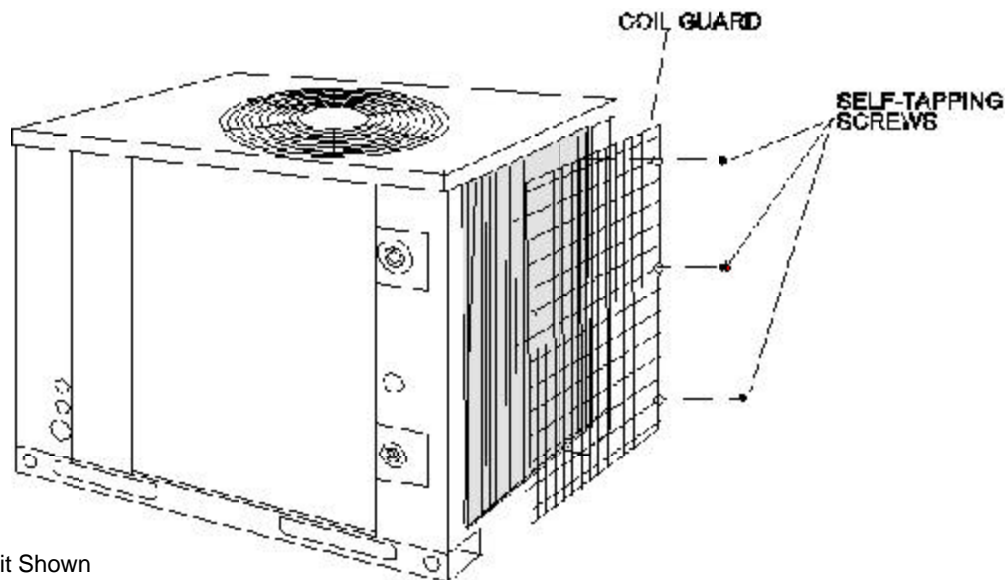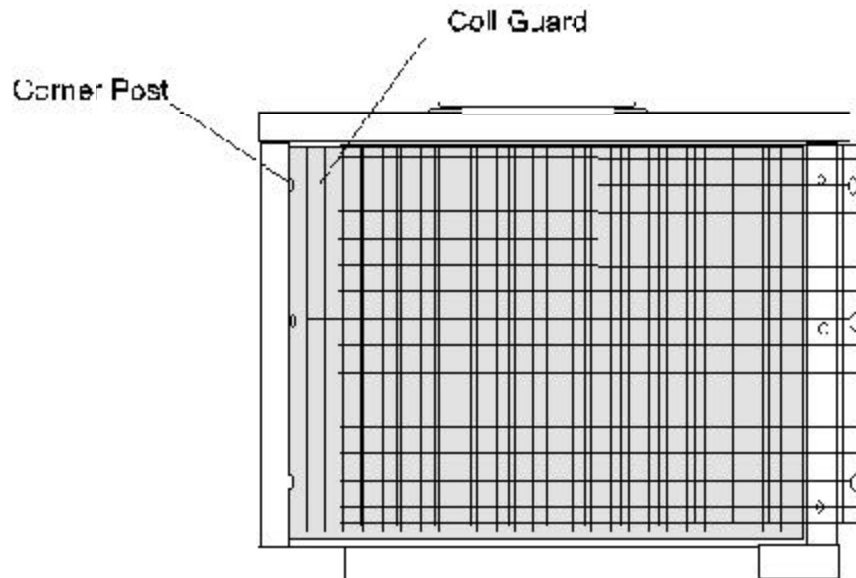

7-1/2 Ton Unit Shown

Subject to change without notice. Printed in U.S.A.
Copyright © by Unitary Products Group 2000. All rights reserved.

Code: SBY, L, F

550.23-N1.3V (600)

Unitary
Products
Group

5005
York
Drive

Norman
Oklahoma
73069